



# POWERTEC 365S 220/380/440V (50149)

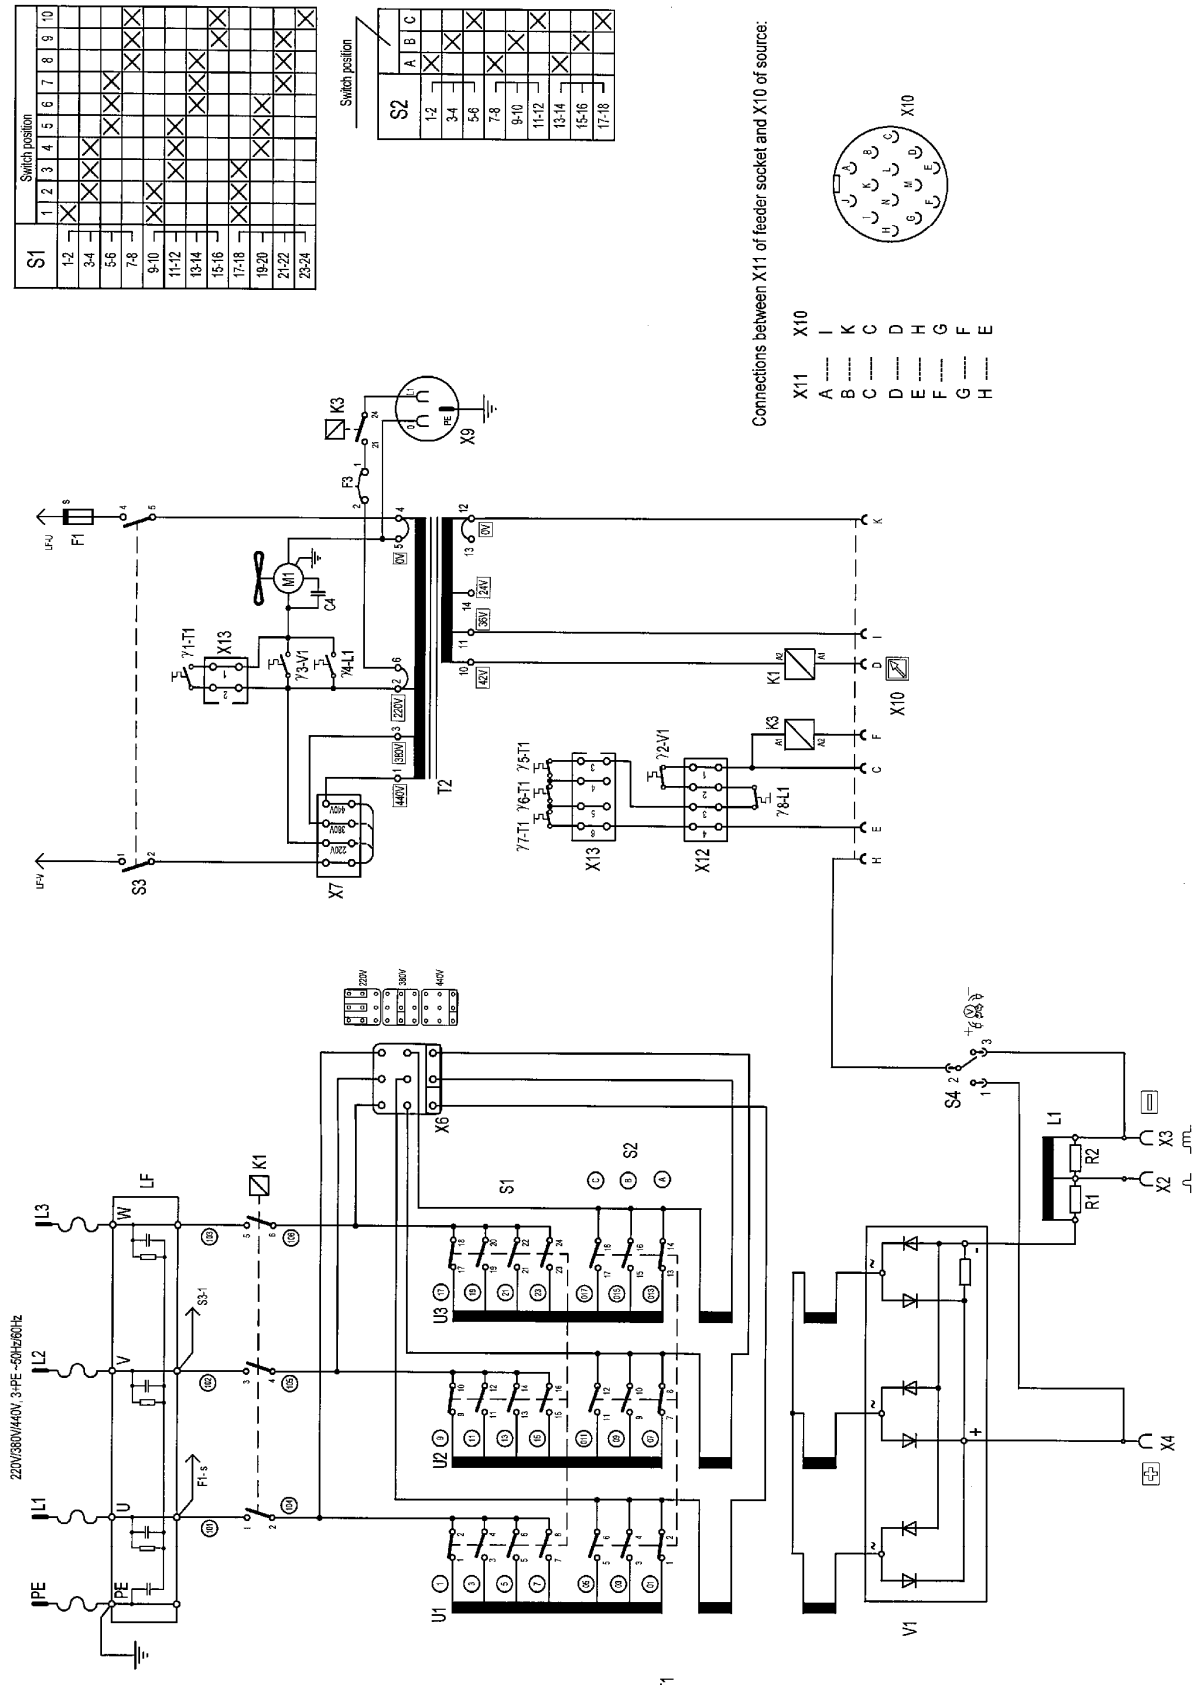

| S1    | Switch position |   |   |   |   |   |   |   |   |    |
|-------|-----------------|---|---|---|---|---|---|---|---|----|
|       | 1               | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
| 1-2   |                 | X |   |   |   |   |   |   |   |    |
| 3-4   |                 |   | X |   |   |   |   |   |   |    |
| 5-6   |                 |   |   | X |   |   |   |   |   |    |
| 7-8   |                 |   |   |   | X |   |   |   |   |    |
| 9-10  |                 |   |   |   |   | X |   |   |   |    |
| 11-12 |                 |   |   |   |   |   | X |   |   |    |
| 13-14 |                 |   |   |   |   |   |   | X |   |    |
| 15-16 |                 |   |   |   |   |   |   |   | X |    |
| 17-18 |                 |   |   |   |   |   |   |   |   | X  |
| 19-20 |                 |   |   |   |   |   |   |   |   |    |
| 21-22 |                 |   |   |   |   |   |   |   |   |    |
| 23-24 |                 |   |   |   |   |   |   |   |   |    |

| S2    | Switch position |   |   |
|-------|-----------------|---|---|
|       | A               | B | C |
| 1-2   |                 | X |   |
| 3-4   |                 |   | X |
| 5-6   |                 |   |   |
| 7-8   |                 | X |   |
| 9-10  |                 |   | X |
| 11-12 |                 | X |   |
| 13-14 |                 |   | X |
| 15-16 |                 | X |   |
| 17-18 |                 |   | X |

Connections between X11 of feeder socket and X10 of source:

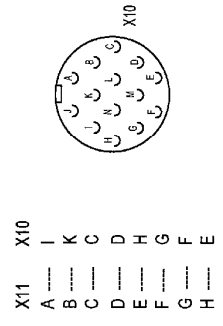

T1